


ANEXA
LA HCYAR

Plan Etaj 2

Scara 1:100

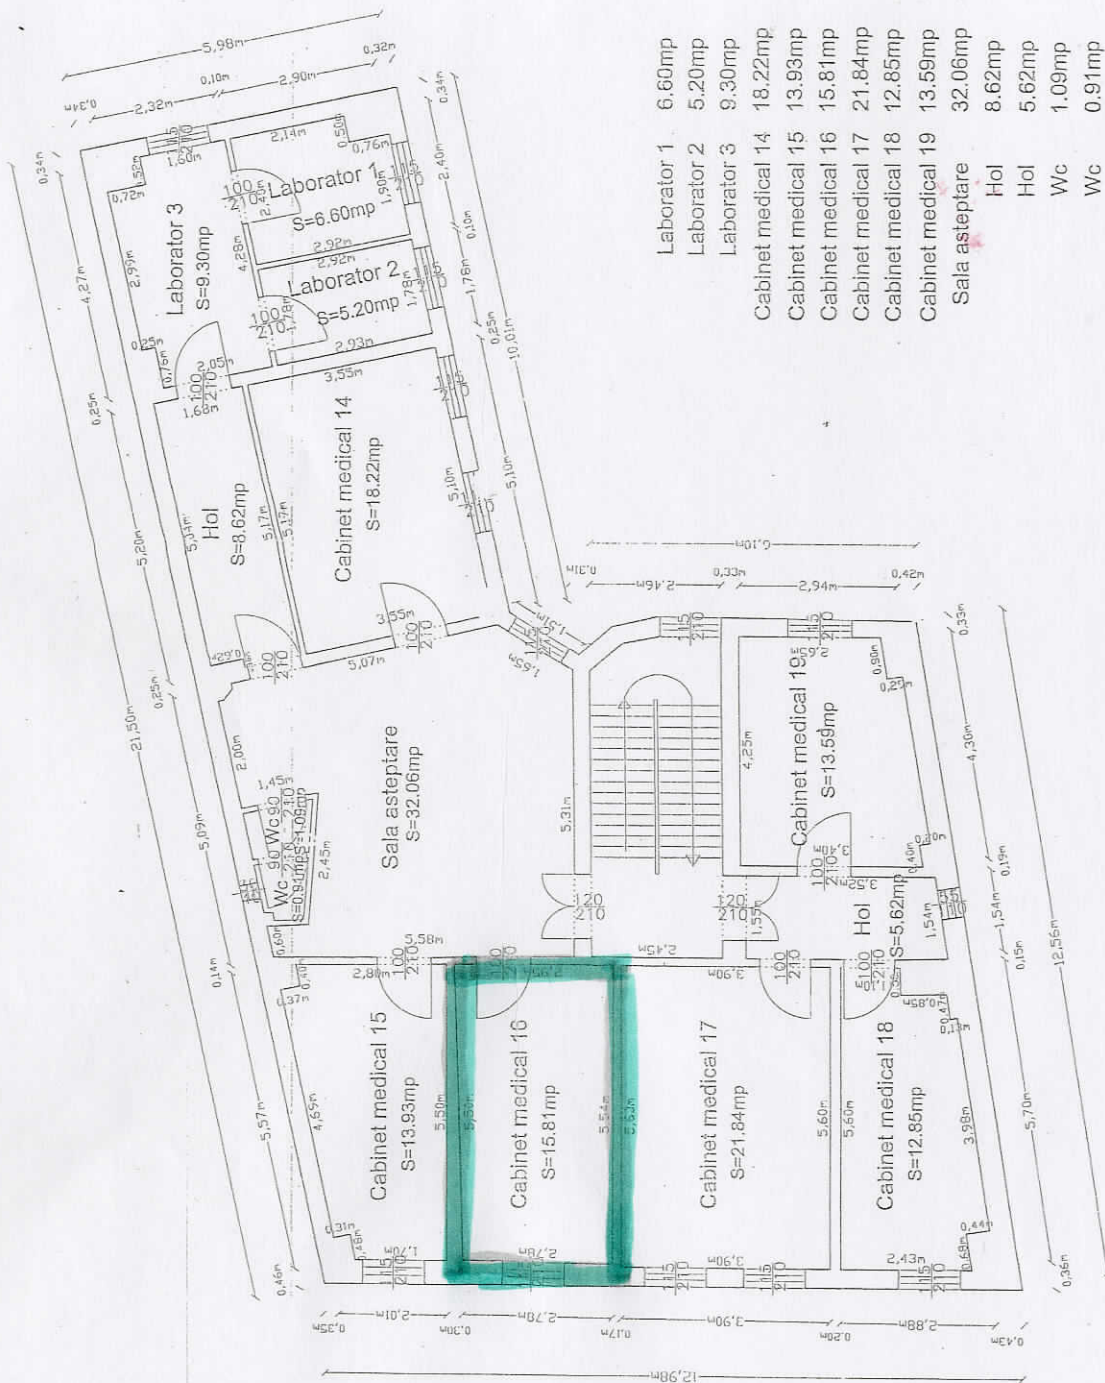

- Laborator 1 6.60mp
- Laborator 2 5.20mp
- Laborator 3 9.30mp
- Cabinet medical 14 18.22mp
- Cabinet medical 15 13.93mp
- Cabinet medical 16 15.81mp
- Cabinet medical 17 21.84mp
- Cabinet medical 18 12.85mp
- Cabinet medical 19 13.59mp
- Sala asteptare 32.06mp
- Hol 8.62mp
- Hol 5.62mp
- Wc 1.09mp
- Wc 0.91mp

